


# COMMERCIAL AND INDUSTRIAL

**PRELIMINARY  
DRAFT**

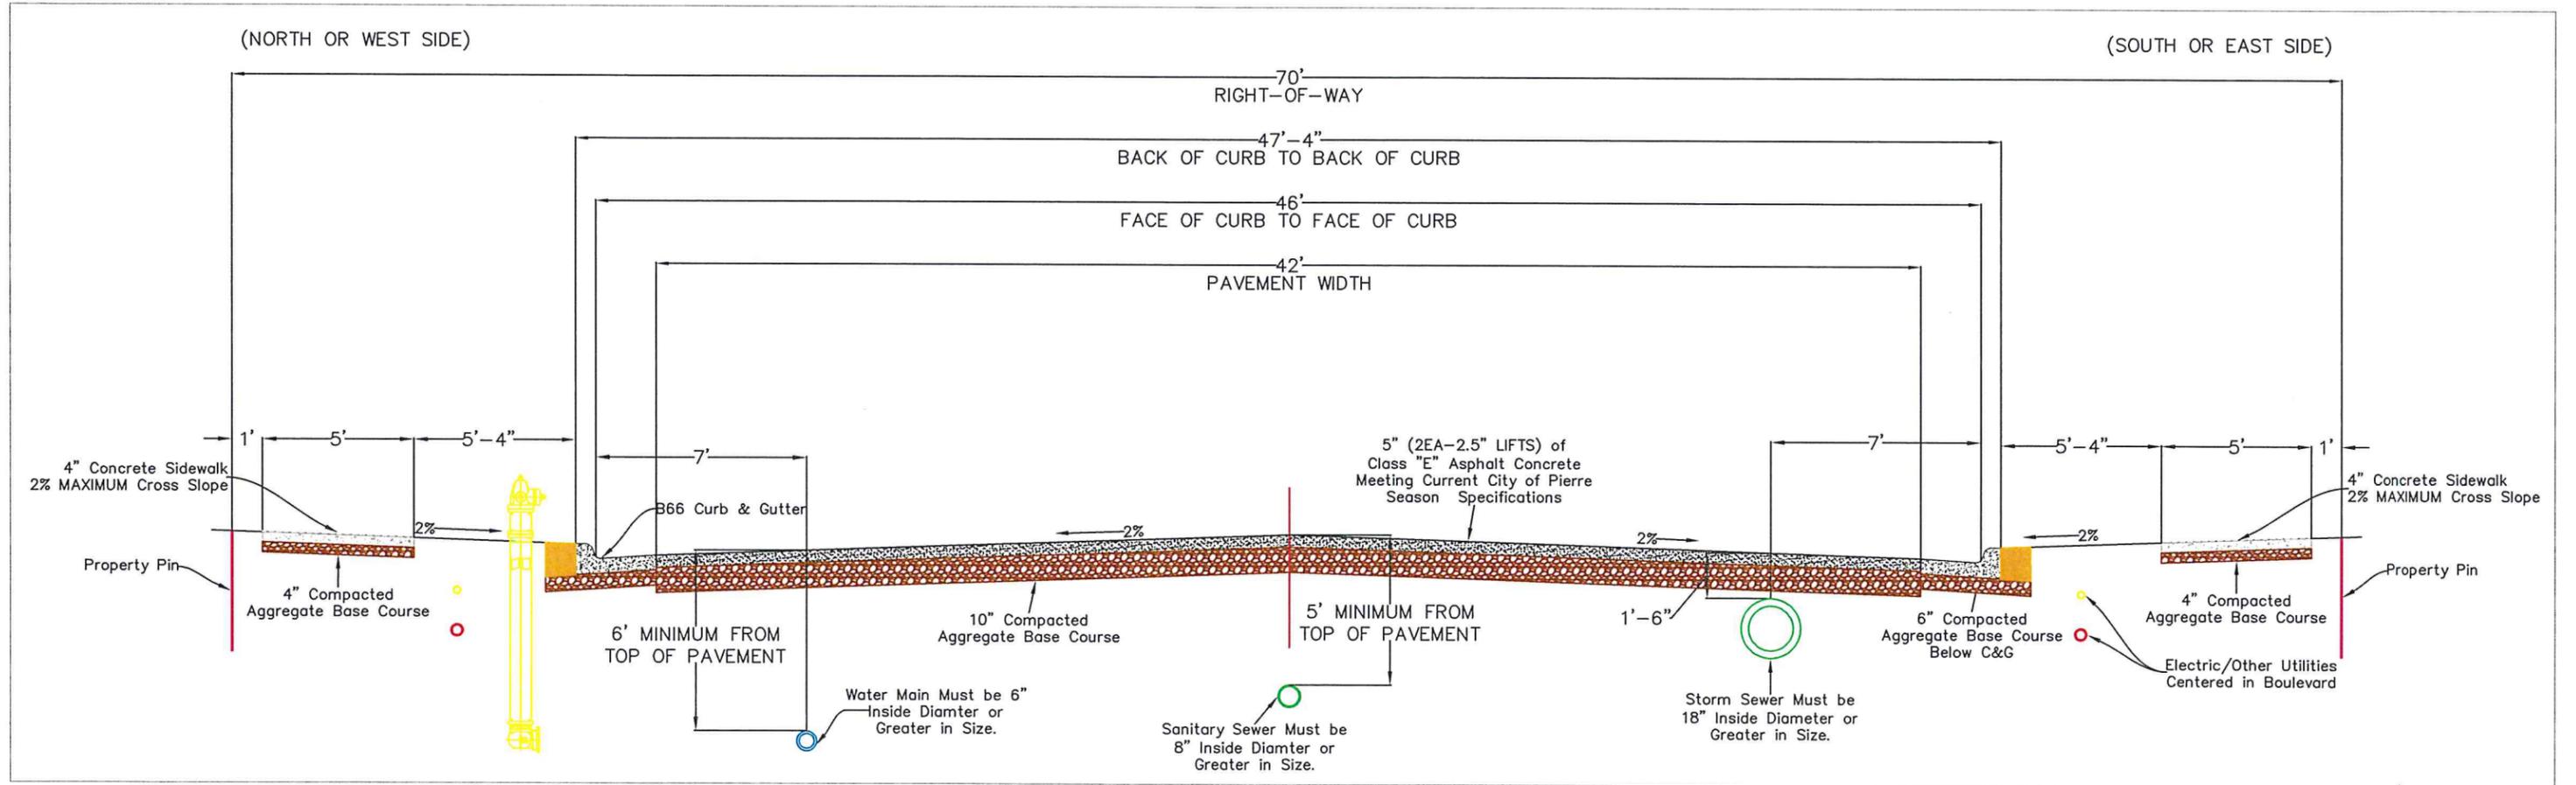

DEPTH OF COVER REQUIREMENTS	
UTILITY	MINIMUM BURY DEPTH
STORM SEWER**	18"
SANITARY SEWER**	60"
WATER**	72"
ELECTRICITY	30" - 40"
GAS*	18"
COMMUNICATIONS*	18"
CABLE TV*	18"

\* Utilities sharing trench with Electric Service must have a minimum vertical separation of 12"  
\*\*10' Lateral Separation is Required from Outside of Pipe to Outside of Pipe.